

PBM

SPECIFICATION FOR APPROVAL

Customer: Customer
Model No: PK3N560B4EA
Motor Type: BE188EC

**PBM Motor and Fan (Suzhou) Co., Ltd**Website: www.pbmmf.com<http://szpbjd.en.made-in-china.com><http://pbmmf.en.alibaba.com>

EMAIL:	XXX@pbmmf.com
TEL:	86-512-68581674
FAX:	86-512-68581574
CELL PHONE:	86-XXX
Factory:	No.8, Zhu Street, Suzhou Industrial Park, Suzhou City, P. R. China 215121
Address:	No.8, Zhu Street, Suzhou Industrial Park, Suzhou City, P. R. China 215121

Customer Approved

Customer

PBM Checked By

Zepsi

This specification defines the Mechanical and Electrical characteristics of the EC brushless external rotor motorized axial fan and centrifugal fan.

Model: PK3N560B4EA

Motor: BE188EC

◆ 1. General Characters

1-1	Rated Voltage	3~380 VAC
1-2	Frequency	50/60 Hz
1-3	Operating Voltage	380-480 VAC
1-4	Rated Speed	1800 RPM
1-5	Input Current	6.5 A
1-6	Input Power	3785 W
1-7	Max Air Flow	20908 m ³ /H
1-8	Max Static Pressure	1600 Pa
1-9	Acoustical Noise	90 dB(A)
1-10	Life Expectance	50,000 Hours(L10) At 40℃ room, humidity 15%~65%RH.
1-11	Direction of Rotation	Clockwise seen on rotor
1-12	Direction of Air Flow	All around
1-13	Insulation Class	Class F
1-14	Insulation Resistance	50 Mega Ohm minimum at 500VDC
1-17	Speed Control	Control input 0~10VDC / PWM / RS485
1-18	Protection Type	IEC 60529 IP54
1-19	Voltage Output	+10 VDC(I _{max} .22mA)
1-20	Dielectric Strength	10mA maximum at 2200VAC 50Hz one second
1-21	Touch current	≤3.5mA

Model: PK3N560B4EA

Motor: BE188EC

◆ 2. Mechanical Characters


2-1	Dimension	800mm X 800mm X 547.7mm (see dimension drawing)
2-2	Material of Impeller	Metal
2-3	Number of Blades	5
2-4	Impeller Plate	Metal
2-5	Mounting Position	Any
2-6	Surface of Rotor	Coated in black
2-7	Bearing System	Ball bearing
2-8	Weight	60kg
2-9	Package	standard

◆ 3. Electrical Protection

3-1	Locked-rotor Protection	Over-current limiting circuit protects motor from damage at least for 72 hours of locked rotor condition at rated voltage.
3-2	Thermal Protection	When the motor temperature reaches the preset limit, reduce power or shut down the unit.
3-3	Over or Less Voltage Protection	When the supply voltage exceeds or falls below the preset voltage range, a shutdown is triggered.
3-4	Soft Start	The motor starts slowly at a lower speed to reduce the starting current and the impact on the power grid.
3-5	Over current Protection	When the motor operating current exceeds the preset value, it will trigger a shutdown or power reduction.
3-6	Speed Limiter	The operating speed of the fan will not exceed the maximum preset value.
3-7	Lack of Phase	Protection is triggered when a power failure of any phase of the motor is detected, preventing overheating caused by the motor's single-phase operation.
3-8	Automatic Restart	The motor will automatically restart after detecting rotation stop or stall conditions.

Model: PK3N560B4EA**Motor: BE188EC****◆ 4. Environmental Characters**

4-1	Operating Temperature	-25℃ to 60℃
4-2	Storage Temperature	-40℃ to 70℃
4-3	Operating Humidity	5% to 95% RH
4-4	Storage Humidity	0% to 95% RH
4-5	Drop Test	ISO 4180
4-6	Vibration Test	IEC 60068-2-64
4-7	Shock Test	IEC 60068-2-29
4-8	RoHS	All the material meets RoHS standard.

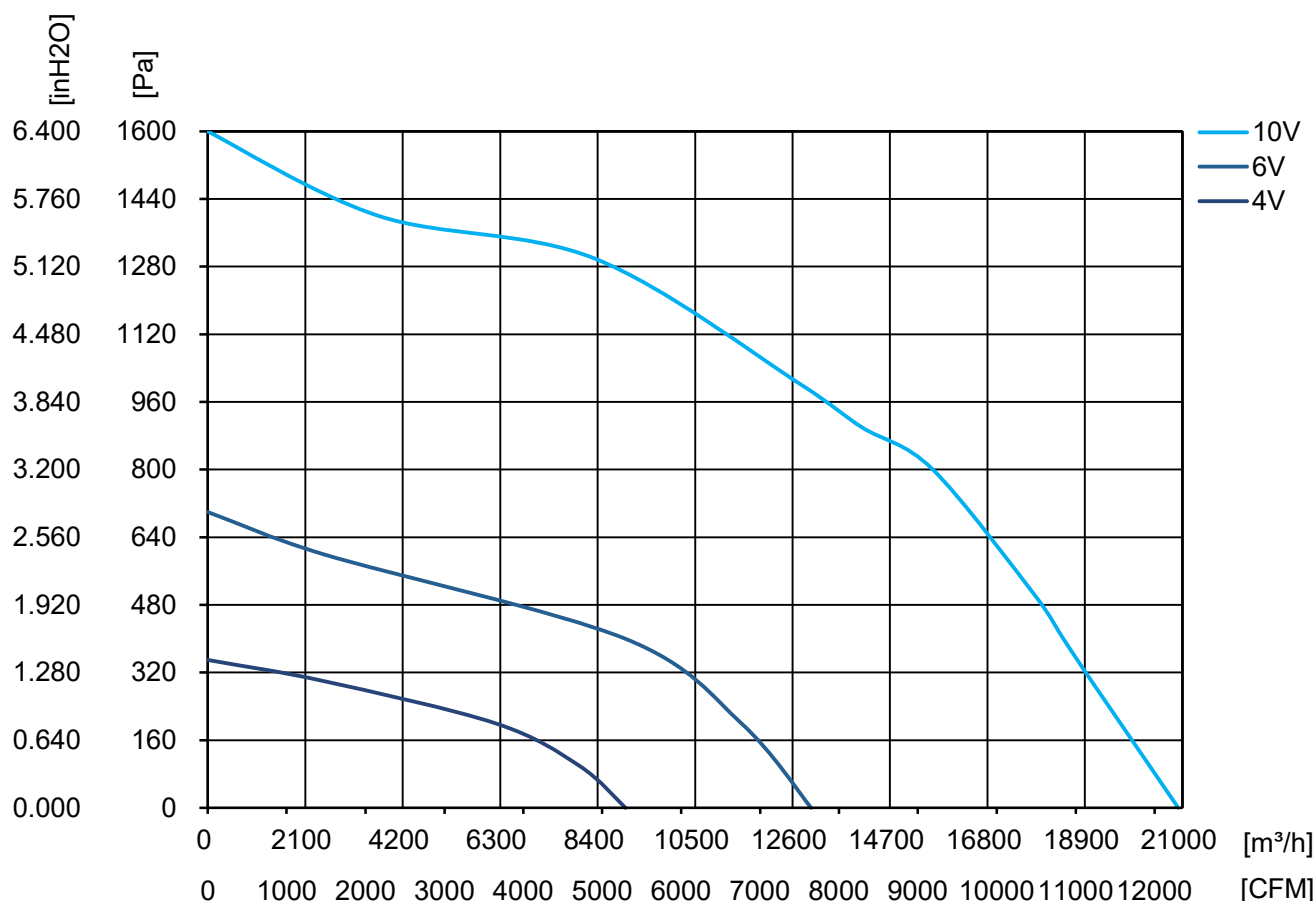Model: PK3N560B4EA**Motor: BE188EC****◆ 5. Performance Curve****Testing Condition**

Input Voltage----Operating voltage

Temperature----Room temperature

Humidity-----65%RH


Standard-----AMCA 210

The air flow rate specified in the specification sheet is measured on PBM measurement equipment. The actual installed air flow rate may vary with changes in installation conditions. In case of deviation from the standard air flow rate, the parameters must be verified on the installed equipment.

Model: PK3N560B4EA

Motor: BE188EC

◆ 6. Outline Drawing

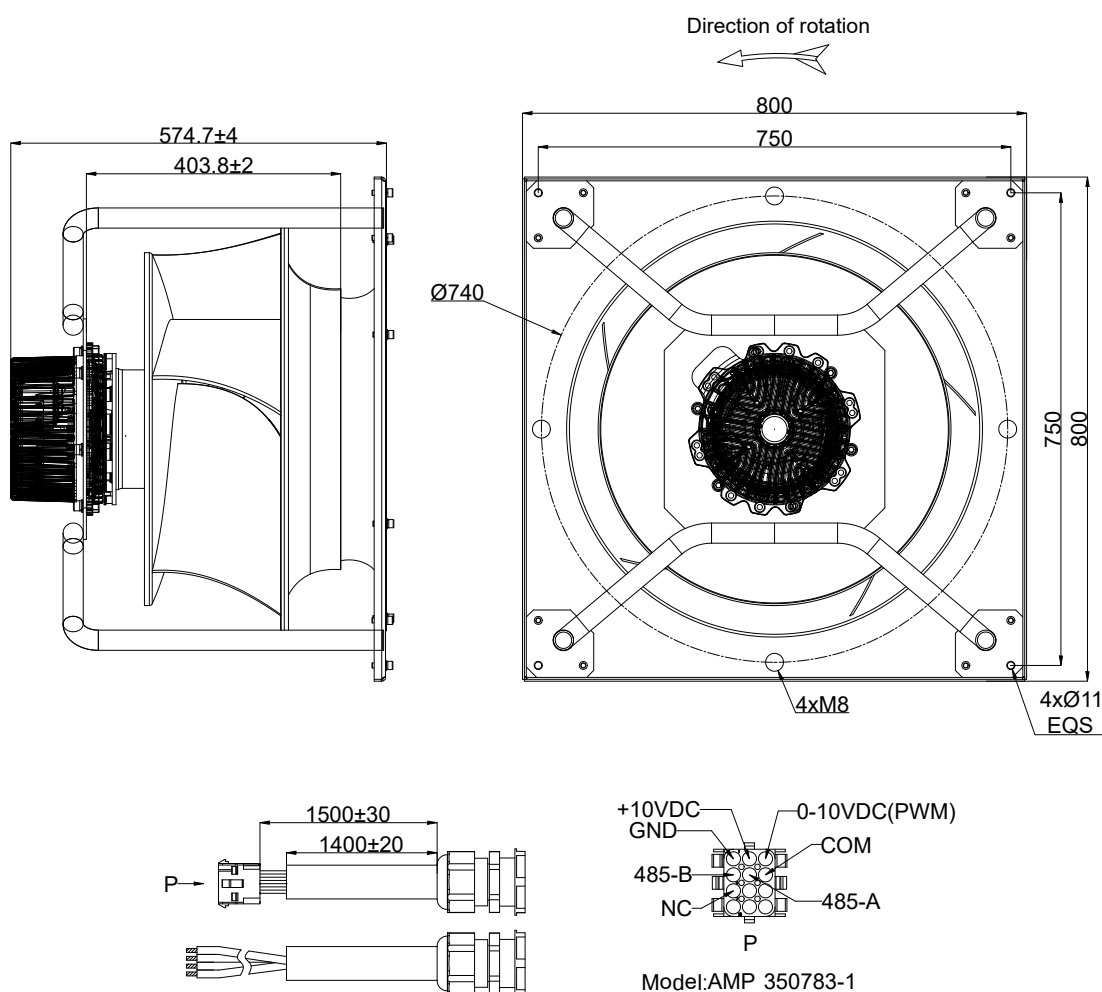


Note

1. Connection line:(4xAWG16#),(7xAWG20#)
2. AC:Black=L1,Yellow=L2,Blue=L3,Green&Yellow=Protecting Earthing;
3. DC:Orange=Voltage Output +10VDC,Violet=0-10VDC/PWM,White=GND,Gray=485-B,
Pink=485-A,Red=COM,Red=NC.

Model: PK3N560B4EA

Motor: BE188EC

7. Connection Diagram

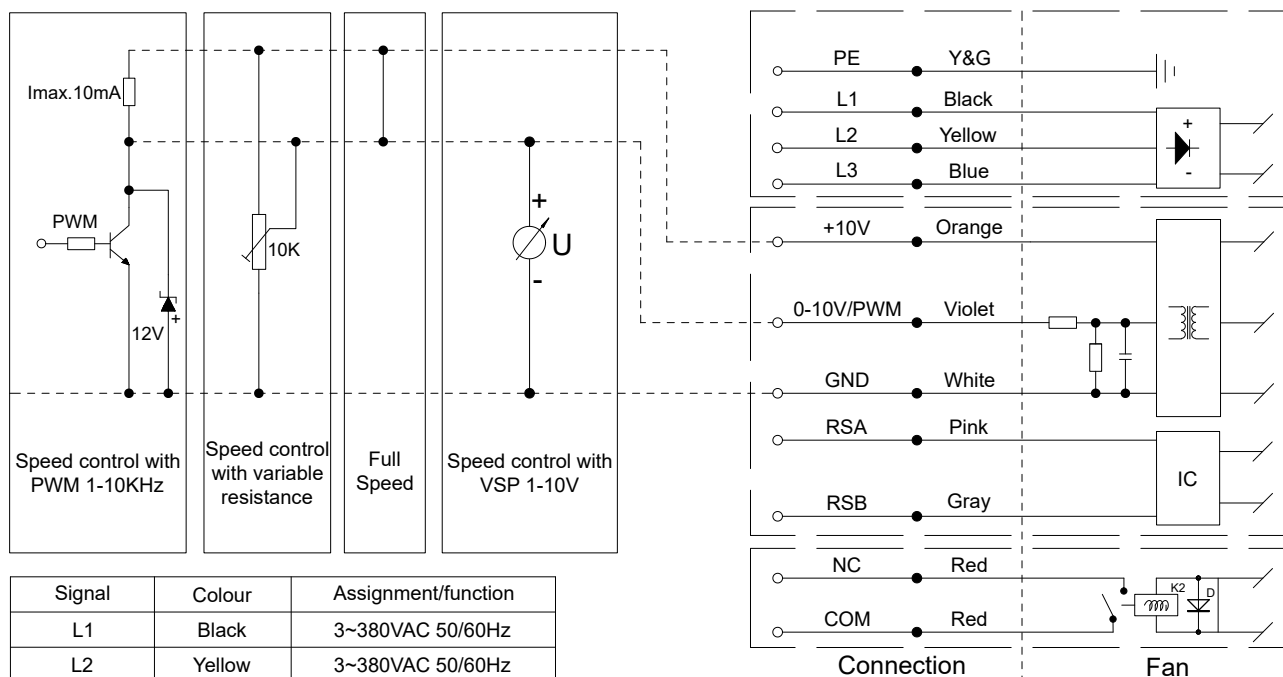

Signal	Colour	Assignment/function
L1	Black	3~380VAC 50/60Hz
L2	Yellow	3~380VAC 50/60Hz
L3	Blue	3~380VAC 50/60Hz
PE	Green&Yellow	Protection Earth
NC	Red	NC
COM	Red	COM
+10VDC	Orange	Voltage Output +10VDC
0-10VDC/PWM	Violet	Control input
GND	White	GND
RSA	Pink	Modbus RSA-485
RSB	Gray	Modbus RSB-485

Note

Above outside circuit connection screen are four kinds of most common speed control circuits.

Model: PK3N560B4EA

Motor: BE188EC

◆ 8. Safety Requirements

- 1.The power line and control line of the fan should be connected in strict accordance with the wiring diagram;
2. If the fan does not work after starting,please check the input voltage of the speed regulation,which may be poorly connected;
- 3.Please do not touch the impeller or rotor under the condition of electrifying or low speed operating;
- 4.Before turning on the power, please check whether the motor is installed reliably;
- 6.Please do not flush the motor,to prevent leakage accidents caused by reducing the insulation performance of the motor;
- 7.If you need to use special customized products,please consult us first and confirm before use;
- 8.After the fan operation stops,the temperature of the motor casing may be high in a short period of time, please avoid direct touch.
- 9.When installing the equipment, pay attention to check the casing and other shells,no debris can fall in, and clean up the inside if necessary;
- 10.Before the fan is installed and running, need to confirm that there is no collision,or jamming before it can be powered on;
- 11.As a part of the fan, the motor cannot be used alone without impeller or load;
- 12.After the product packaging has been disassembled, it should be repackaged if it needs to be kept instorage. The product shall be stored in a clean, well-ventilated warehouse with ambient temperature of $-40^{\circ}\text{C}\sim+80^{\circ}\text{C}$, relative humidity of no more than 95%, no corrosive gases in the air, and 15cm above the ground;
- 13.Please read this technical specification carefully before use,all operations shall be performed by qualified professionals.